


MONTE VISTA WATER DISTRICT  
10575 Central Avenue  
Post Office Box 71  
Montclair, CA 91763

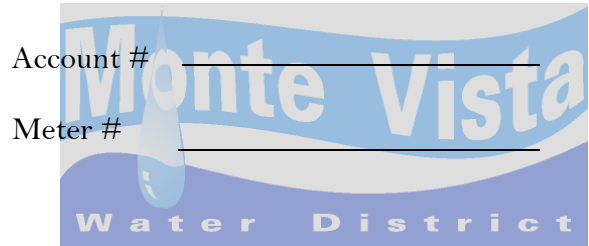

**Water Utility Account  
Hydrant Meter Agreement & Application**

---

Requirements of Use: \_\_\_\_\_ Customer initials acknowledge understanding of the requirements below  
The District reserves the right to terminate this agreement without warning.

- ◆ A \$1000.00 deposit, paid in advance is required for hydrant meter service.
- ◆ A backflow prevention device (RP) must be installed on all hydrant meters before water is consumed.
- ◆ Customer will be responsible for backflow assembly.
- ◆ Authorized water consumption will not be granted until the backflow device has been successfully tested by a certified San Bernardino County backflow tester and the passing results submitted to the District. To obtain a listing of certified testers, please contact the San Bernardino Safe Drinking Water Division at (909) 387-4666.
- ◆ No part of the installation shall protrude into traffic or pose a safety hazard to pedestrians or vehicles. If necessary, safety warning devices must be in place.
- ◆ Use only a hydrant meter wrench to operate the hydrant. When using the service, slowly open and close the hydrant to prevent water hammer.
- ◆ Meter is subject to removal if payment is not received by indicated due date, and will be subject to a \$20 Reconnect Fee.
- ◆ Applicant will be charged for a replacement meter or repairs in the event the meter is damaged, lost or stolen.
- ◆ Drawing water from a District hydrant without the use of a meter, unauthorized removal of the meter, or tampering with the meter or locking device will result in a forfeiture of the deposit.
- ◆ Only District staff is authorized to move hydrant meters. If relocation is required, the applicant must notify the District 24 hours in advance and pay the hydrant meter relocation fee.

---

Today's Date \_\_\_\_\_ Requested Service Commencement Date (allow 3 days for installation) \_\_\_\_\_

Service Location \_\_\_\_\_ (Street Address) City \_\_\_\_\_

Applicant Name \_\_\_\_\_ Company \_\_\_\_\_

Billing Address \_\_\_\_\_ City \_\_\_\_\_ Zip \_\_\_\_\_


Telephone # ( ) \_\_\_\_\_ Cell ( ) \_\_\_\_\_

DL# \_\_\_\_\_ DL State \_\_\_\_\_ Federal Tax ID# or SS# last four digits \_\_\_\_\_

---

The undersigned applicant accepts responsibility for payment of all charges for water services provided by the Monte Vista Water District and agrees to comply with all District regulations governing such services as outlined in the District's Administrative Code.

Signature \_\_\_\_\_ Date \_\_\_\_\_

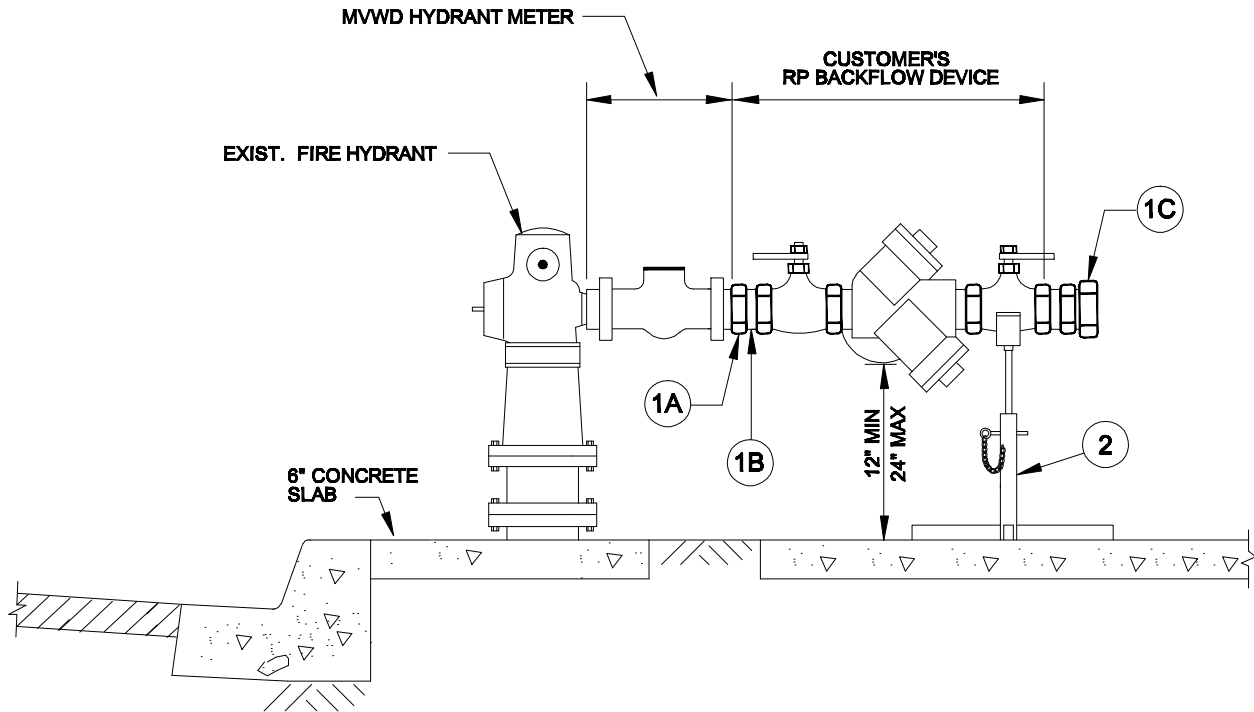

**NOTES:**

1. **PARTS NEEDED:**
  - 1A. FEMALE 2 1/2" NST "SWIVEL TYPE ADAPTER" (NATIONAL SANITARY THREAD) X MALE 2" IPT FOR CONNECTING RP TO HYDRANT METER.
  - 1B. 2" CLOSE NIPPLE.
  - 1C. 2" FEMALE IPT X 2 1/2" MALE NST FOR CONNECTING STANDARD FIRE HOSE TO BACKFLOW PREVENTION DEVICE. THE DEVICE AND FITTINGS ARE AVAILABLE AT MANY PLUMBING SUPPLY BUSINESSES.
2. **A SUPPORT FOR THE BACKFLOW PREVENTION DEVICE MUST INSTALLED USING ANY SUITABLE MATERIAL.**
3. **NO PART OF THE INSTALLATION SHOULD PROTRUDE INTO TRAFFIC OR POSE A SAFETY HAZARD TO PEDESTRIANS OR VEHICLES. IF NECESSARY, PLACE SAFETY WARNING DEVICES.**
4. **USE A HYDRANT METER WRENCH TO OPERATE THE HYDRANT. WHEN USING THE SERVICE, SLOWLY OPEN AND CLOSE THE HYDRANT TO PREVENT WATER HAMMER.**
5. **SLOWLY OPEN AND CLOSE VALVES ON EITHER END OF BACKFLOW PREVENTION DEVICE TO PREVENT WATER HAMMER, INCLUDING VALVE AT END OF HOSE.**
6. **REMOVE HOSE FROM DEVICE AT END OF EACH DAY'S USE.**



BACKFLOW PREVENTION ASSEMBLY  
 REDUCED PRESSURE DEVICE  
 FOR HYDRANT METER SERVICE

APPROVED BY DISTRICT ENGINEER:

VAN M. JEW, P.E.

HYDRANT METER PACKET

REVISED DATE: 4-2010